



ORIGINAL SIGNED & SEALED BY
N.Y. P.E. (OR R.A.)


**Joseph R. Loring
& Associates, Inc.**
consulting engineers

One Pennsylvania Plaza
New York, New York 10019-0043
Tel (212) 563-7400. Fax (212) 563-7382

THE OFFICE OF
DAVID
ELLIOT
LEBOWITZ
PC

**LESLIE E ROBERTSON
ASSOCIATES, R.L.P.**
CONSULTING STRUCTURAL ENGINEER
25 EAST 40TH STREET
NEW YORK, NY 10018-3609
TEL. 212/780-8000 FAX 212/780-8000

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT
 COPY OF ONE OF THE CONTRACT DRAWINGS CON-
 STITUTING A PART OF CONTRACT NO. WTC-2052-6
 IN THE FORM IN WHICH SAID DRAWINGS WERE AT-
 TAINED BY THE SAID CONTRACT WAS EXECUTED BY
 SAID PARTIES.
 SIGNED: 11/6/93 Smiley A. Acker
 SPECIAL MASTER
 DATE: 4/10/98 P.K. [Signature]

	12/12/97	INDICATE ANCHOR LOCATION	

No.	Date	Revision	Approval
Engineering Department			
Design Divisions			

The
World
Trade
Center

STANDBY POWER
5 WORLD TRADE CENTER


MECHANICAL
5 WTC 9TH FLOOR
MER PART PLANS

This drawing subject to conditions in contract.
All inventions, ideas, designs and methods
therein are reserved to Port Authority and
may not be used without it's written consent.

J.D. M.A.R. _____
Designed by Drawn by Check by

Date 11/17/97 Score AS NOTED

Contract Number **WTC-845.071** Drawing Number **M2-02**

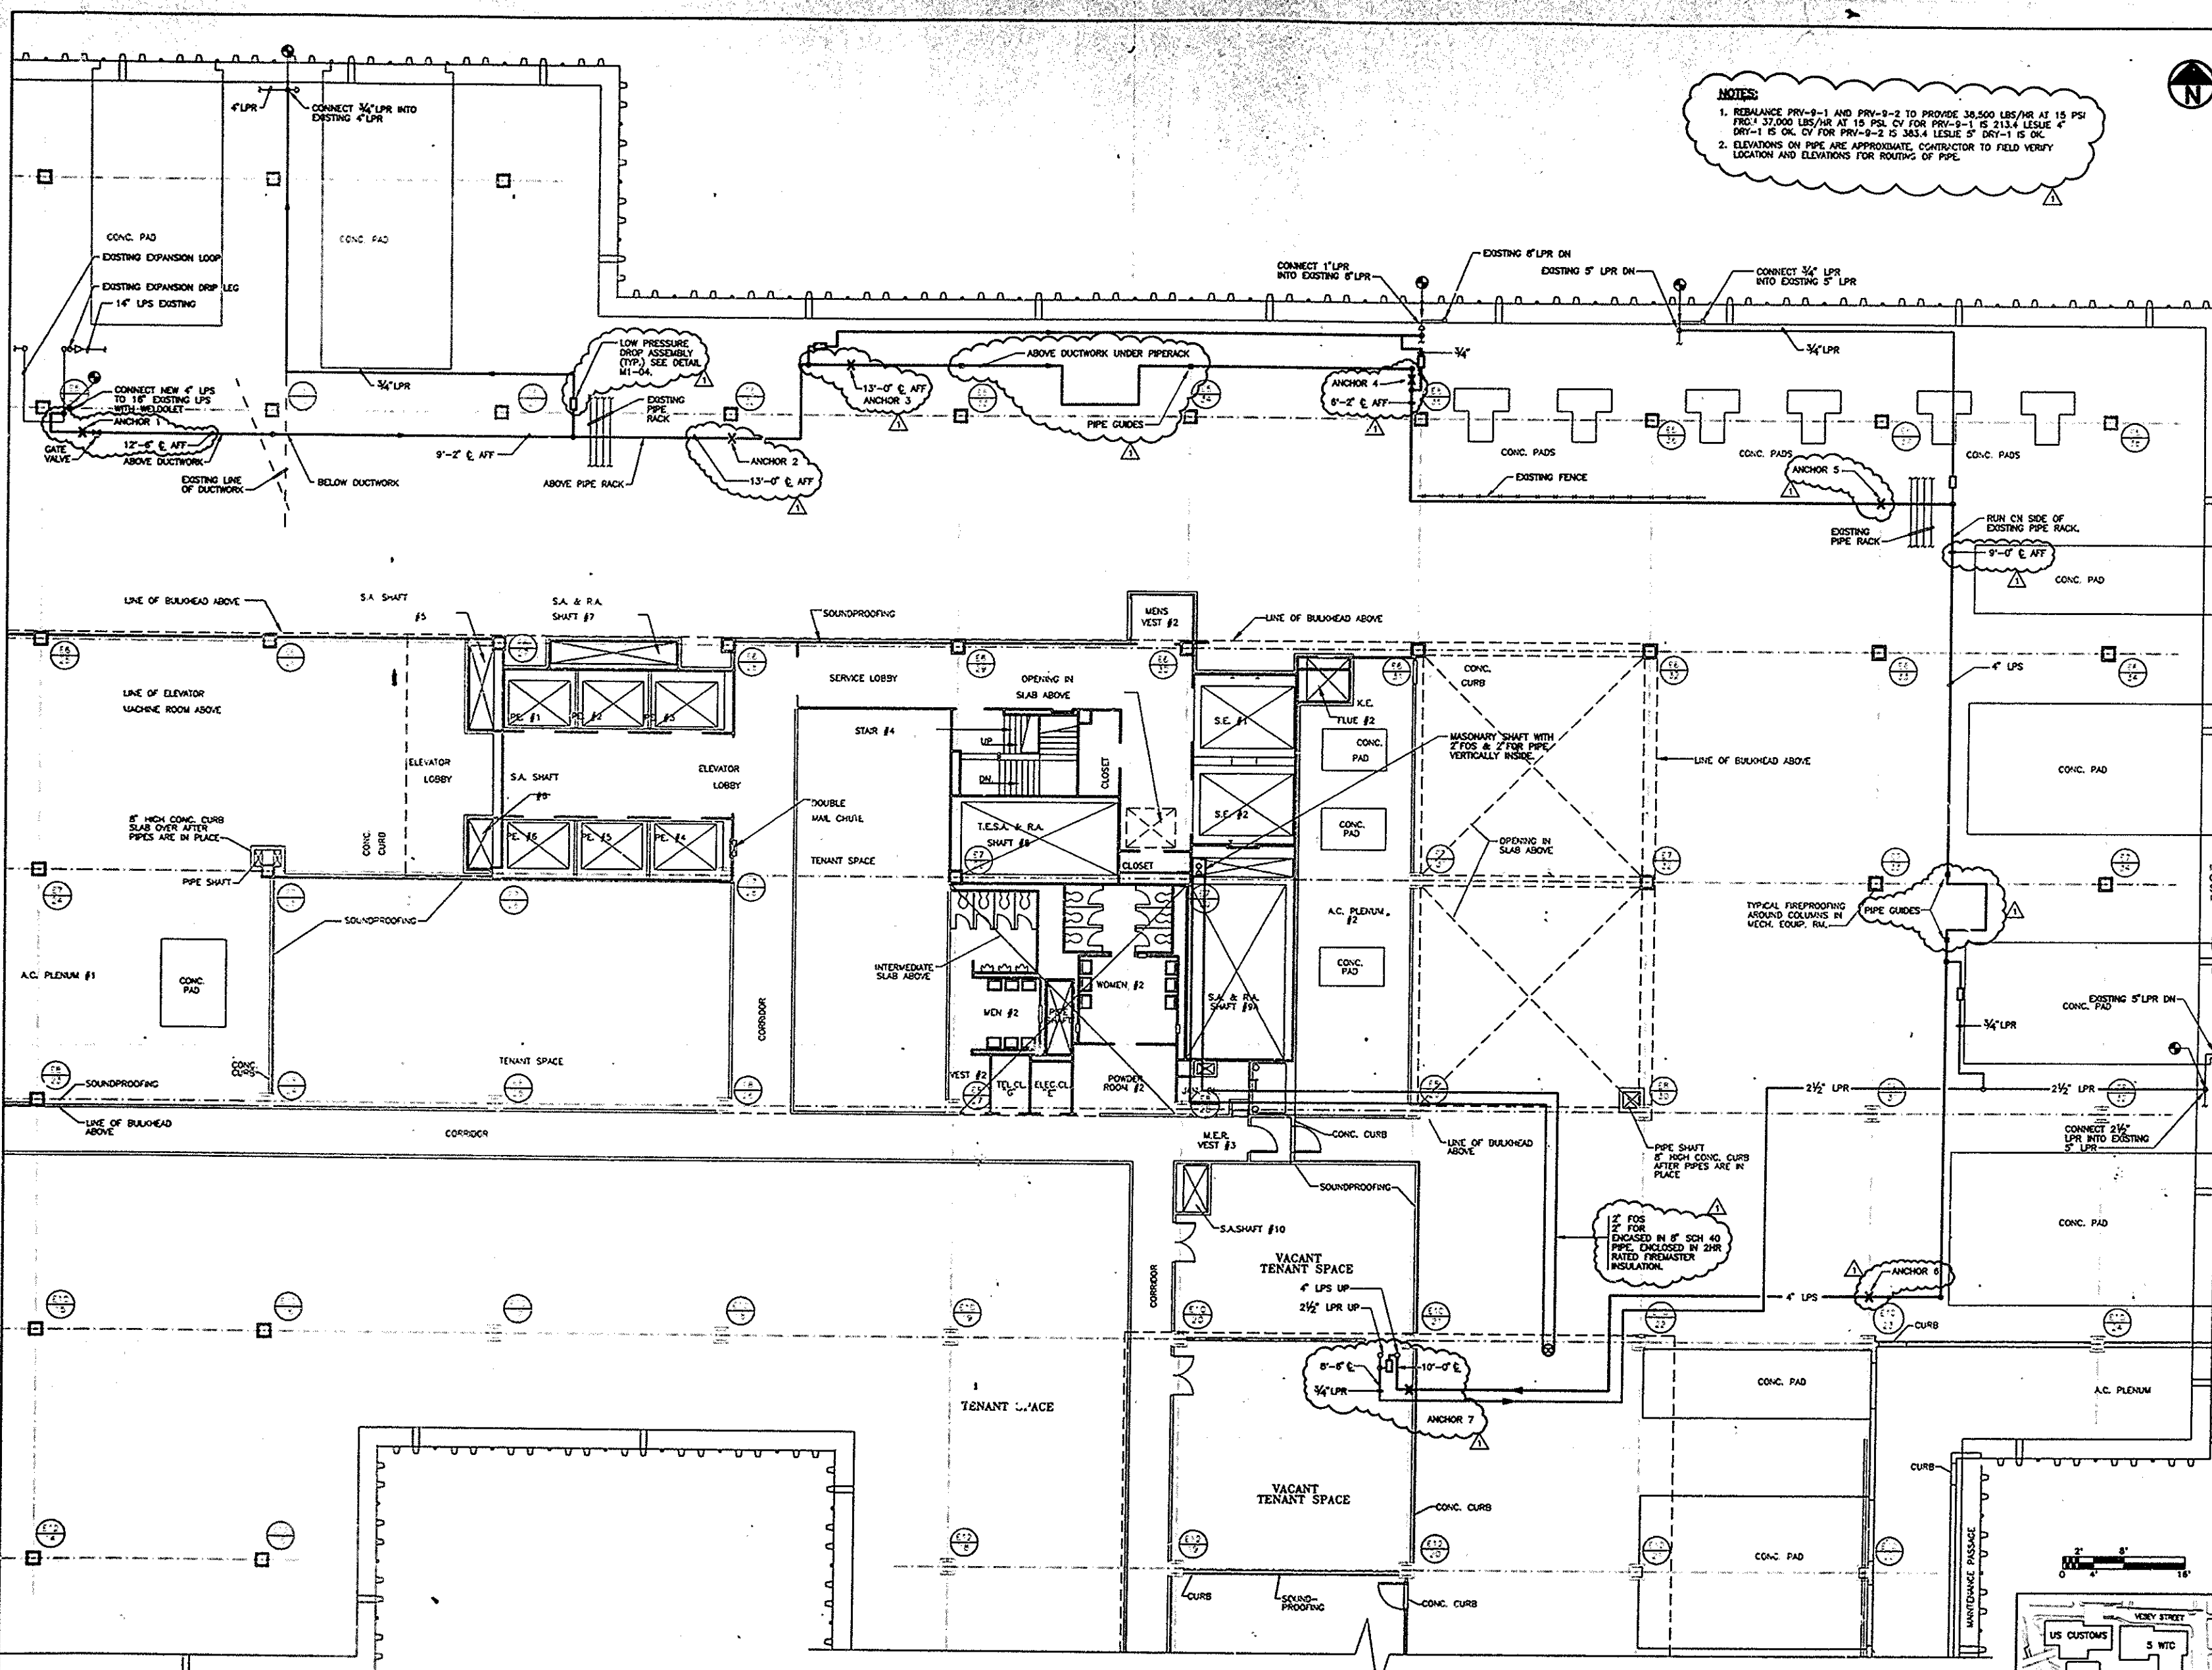

NOTES:

1. REBALANCE PRV-9-1 AND PRV-9-2 TO PROVIDE 38,500 LBS/HR AT 15 PSY. 37,000 LBS/HR AT 15 PSY FOR PRV-9-1 IS 213.4 LESUE 4" DRY-1 IS OK. CV FOR PRV-9-2 IS 363.4 LESUE 5" DRY-1 IS OK.
2. ELEVATIONS ON PIPE ARE APPROXIMATE. CONTRACTOR TO FIELD VERIFY LOCATION AND ELEVATIONS FOR ROUTING OF PIPE.

